

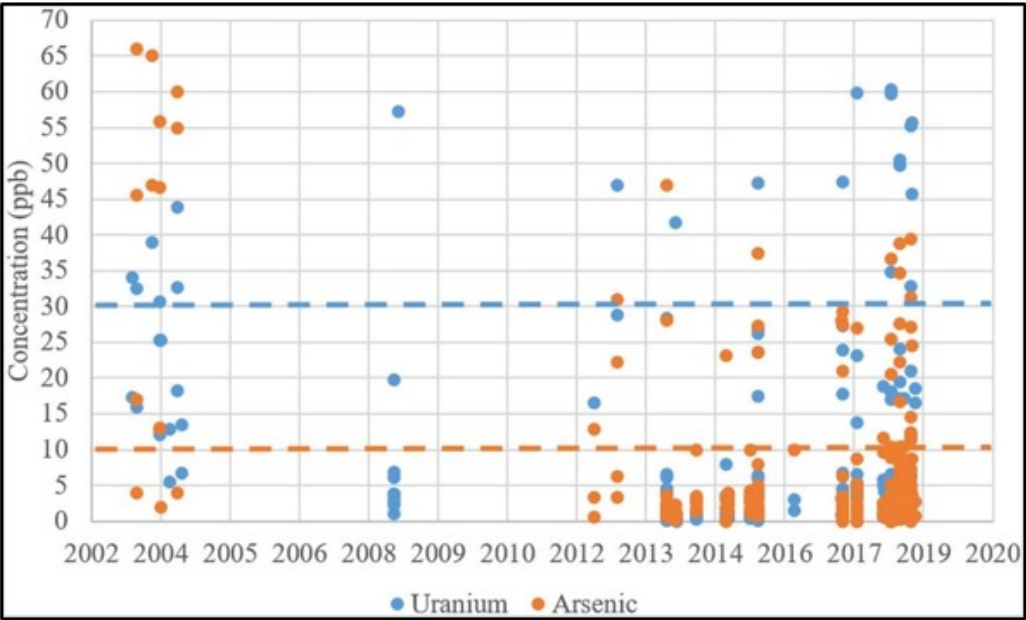


Navajosafewater.org

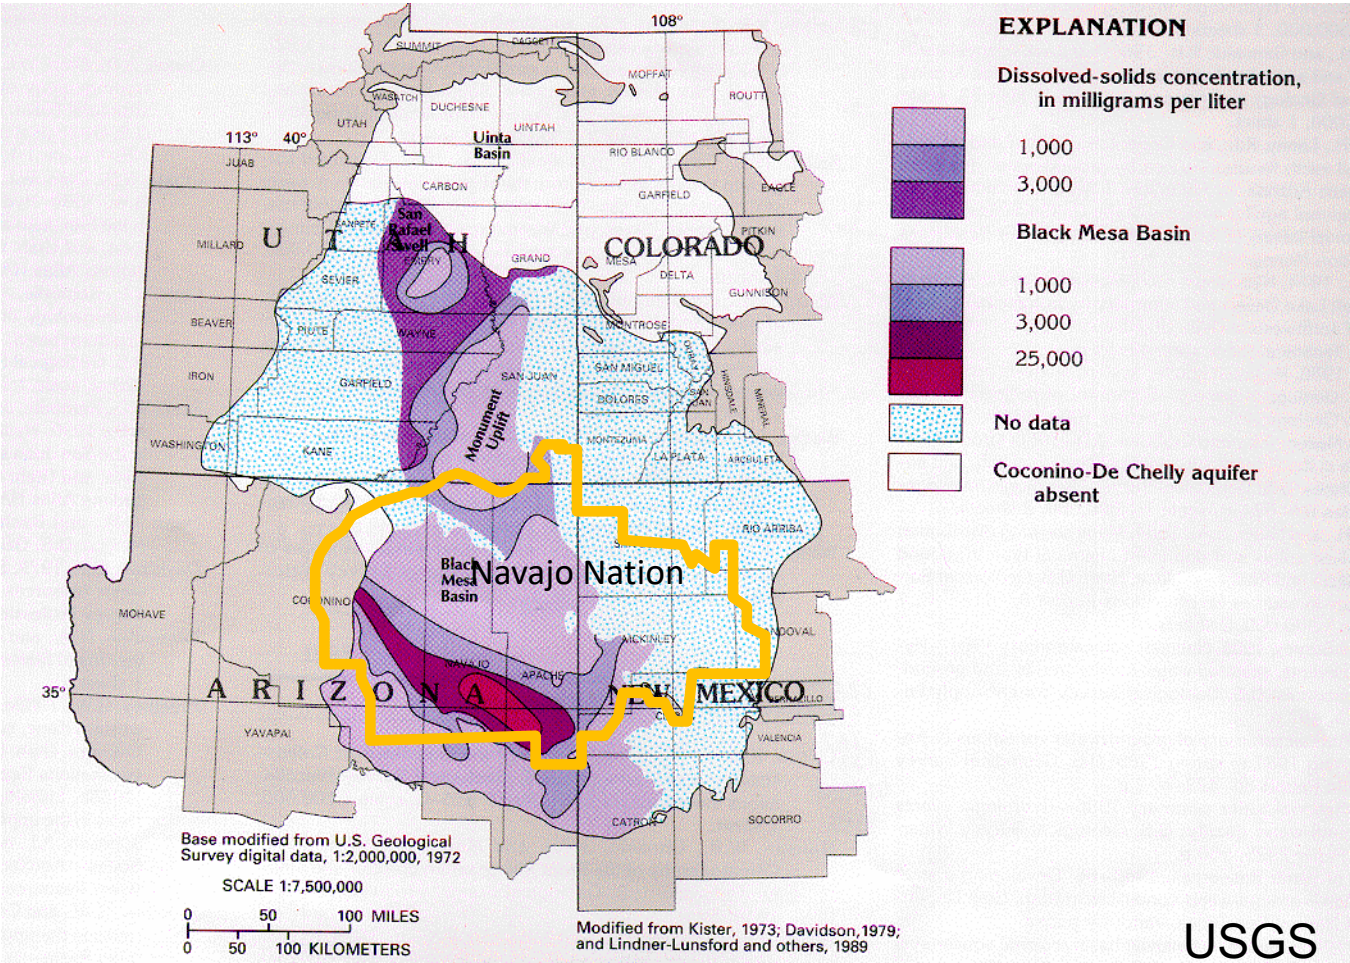

# WATER QUALITY CHALLENGES

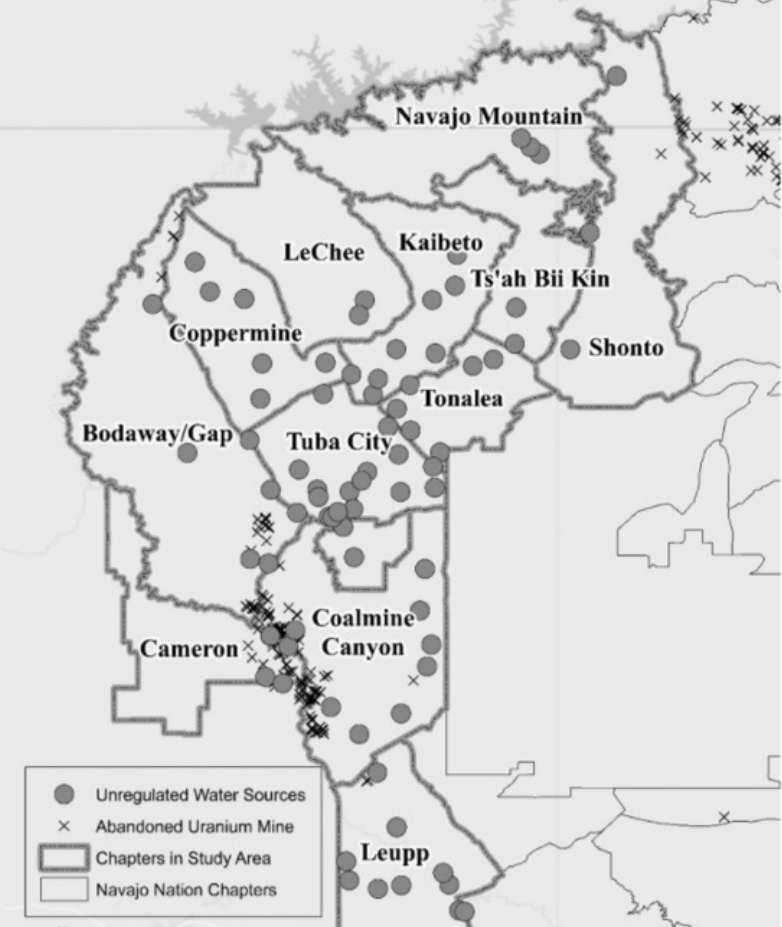


Ingram et al. 2020, J Vac Sci Technol A.


The maximum contaminant level (MCL) for uranium in drinking water set by the US EPA is 30 micrograms per liter ( $\mu\text{g/L}$ ) for uranium, 10 micrograms per liter for arsenic. The secondary drinking water standard for total dissolved solids is less than 500 milligrams per liter.




# Map of Navajo Nation Water Rights Claims

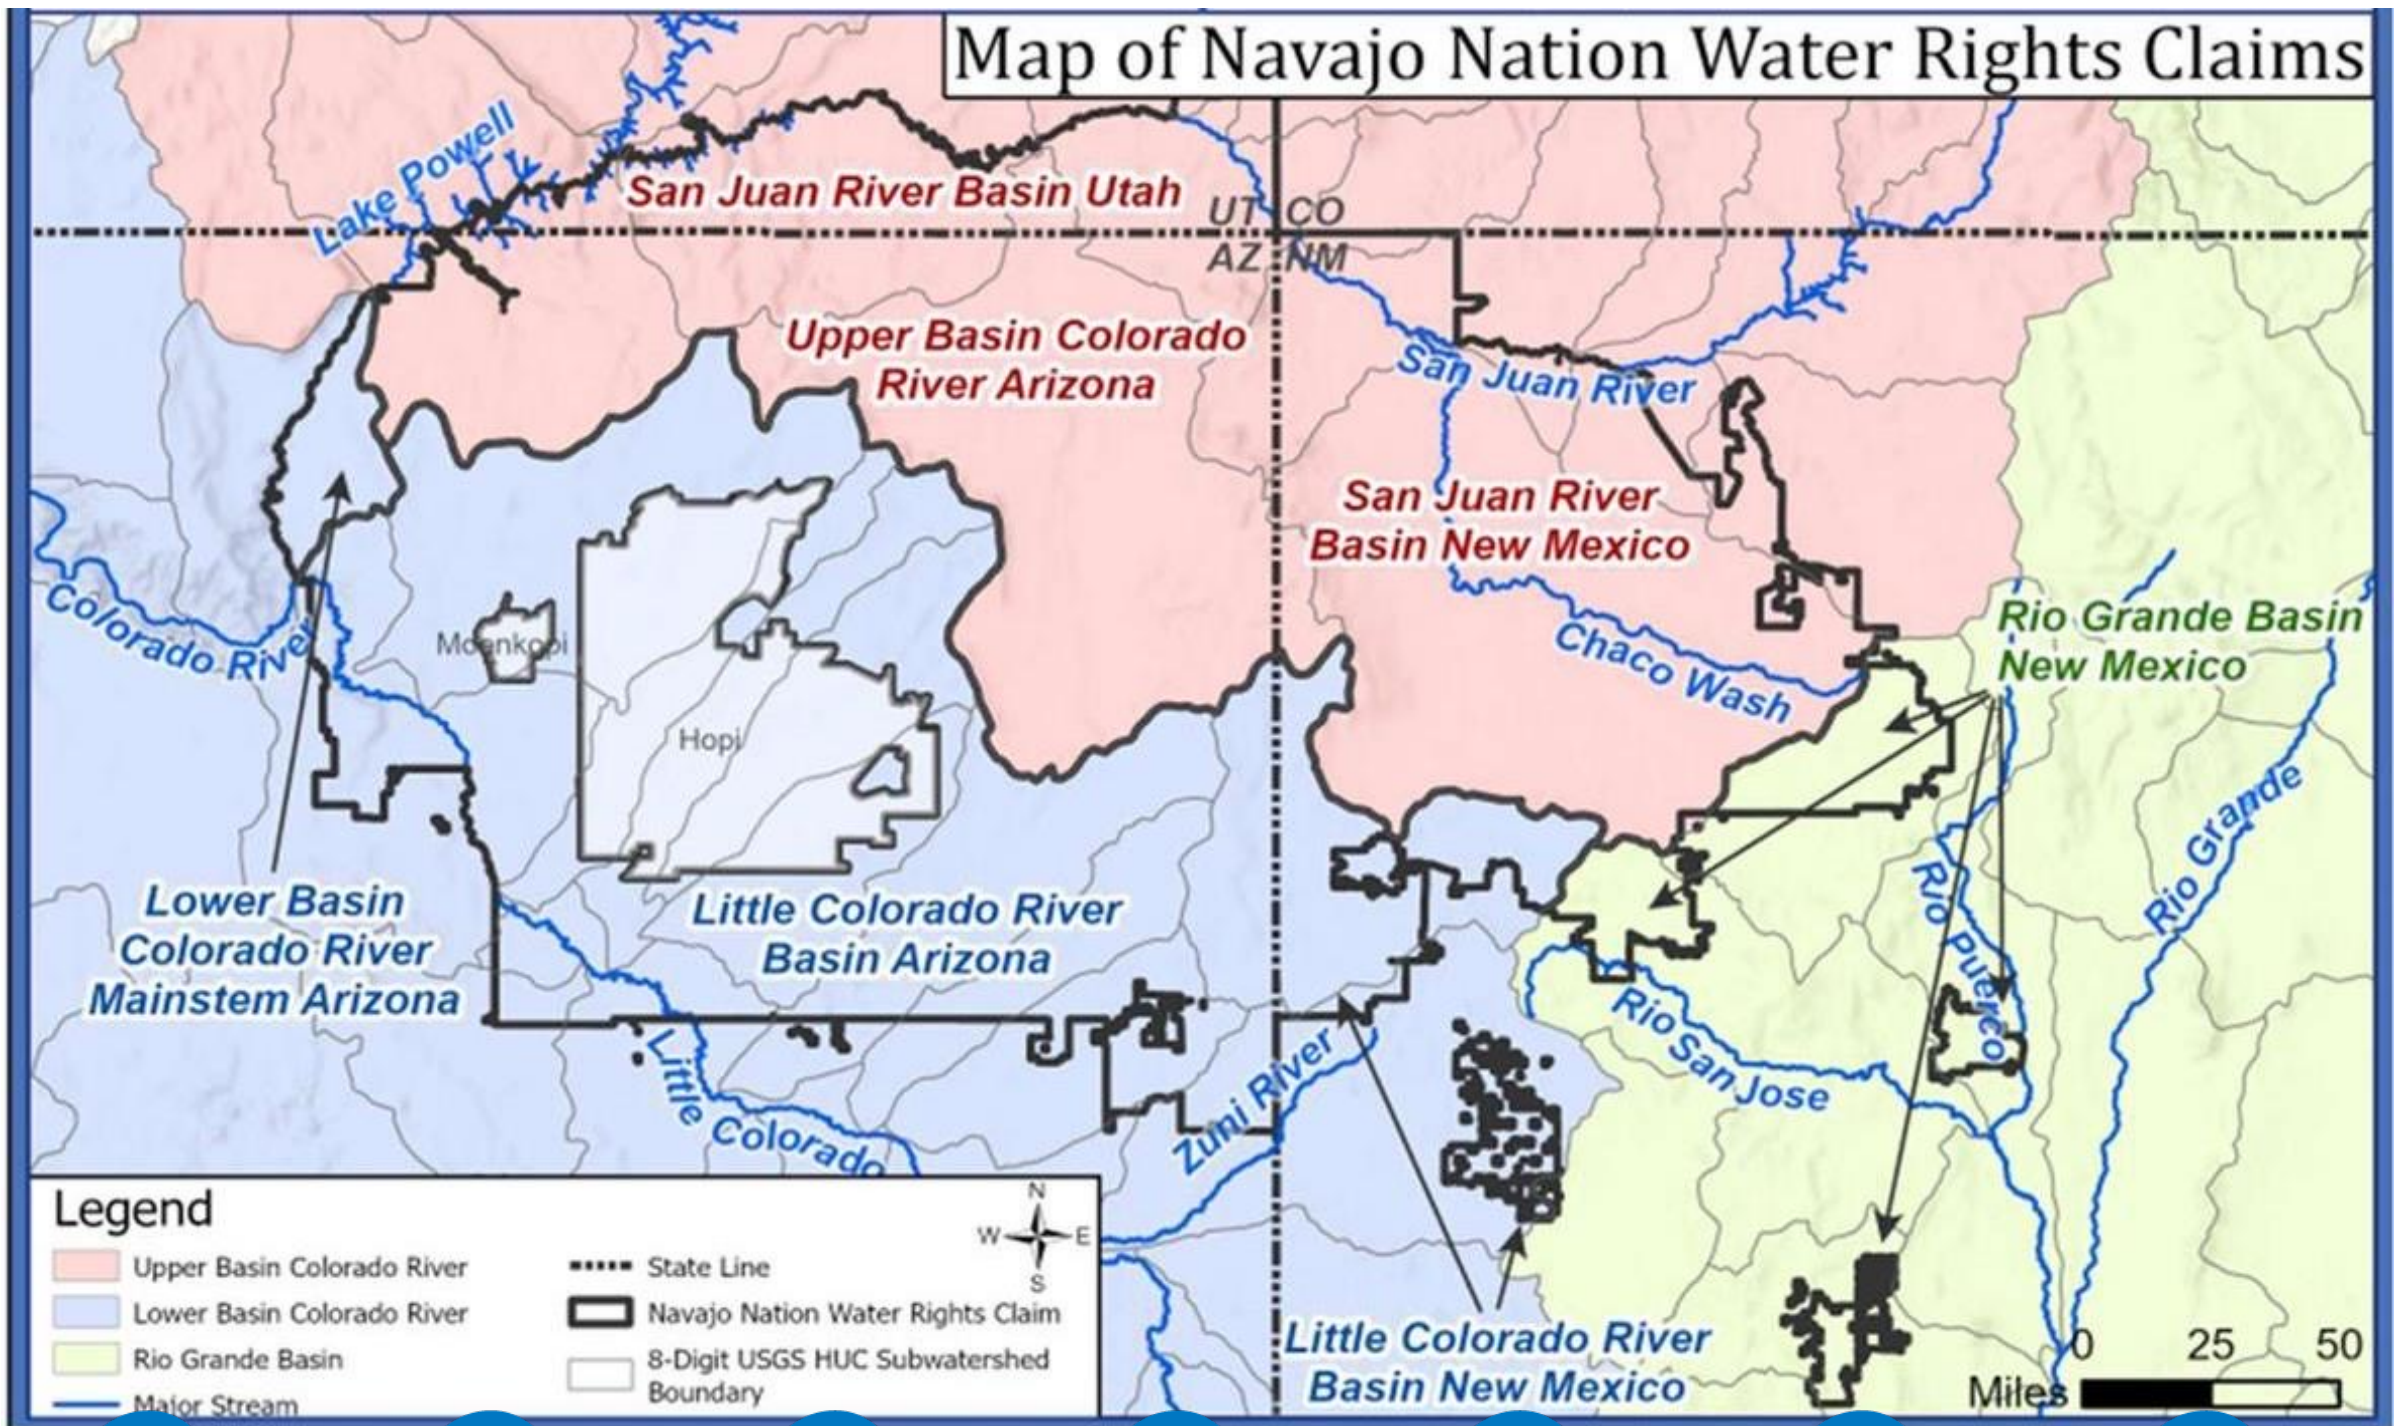




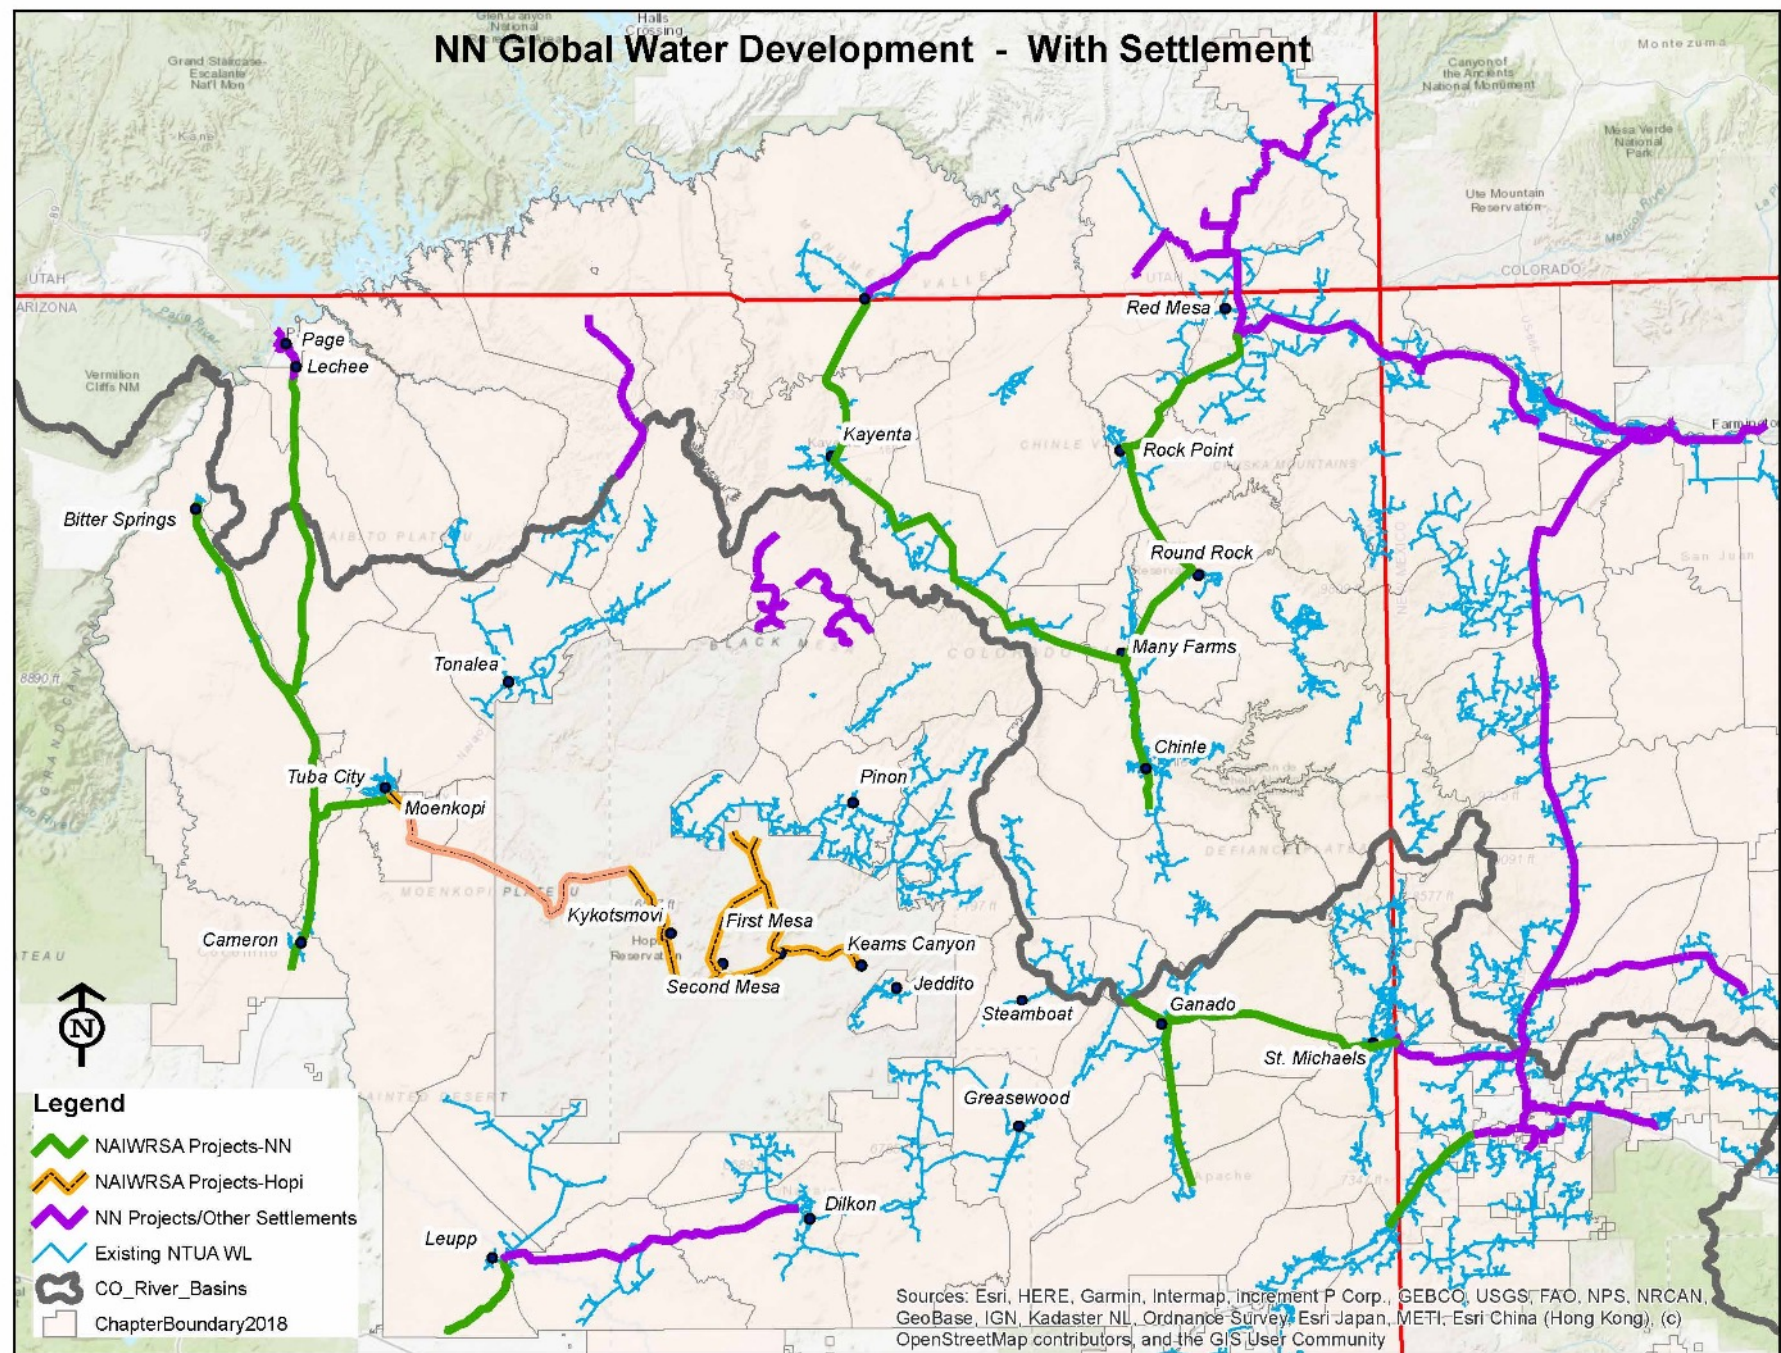



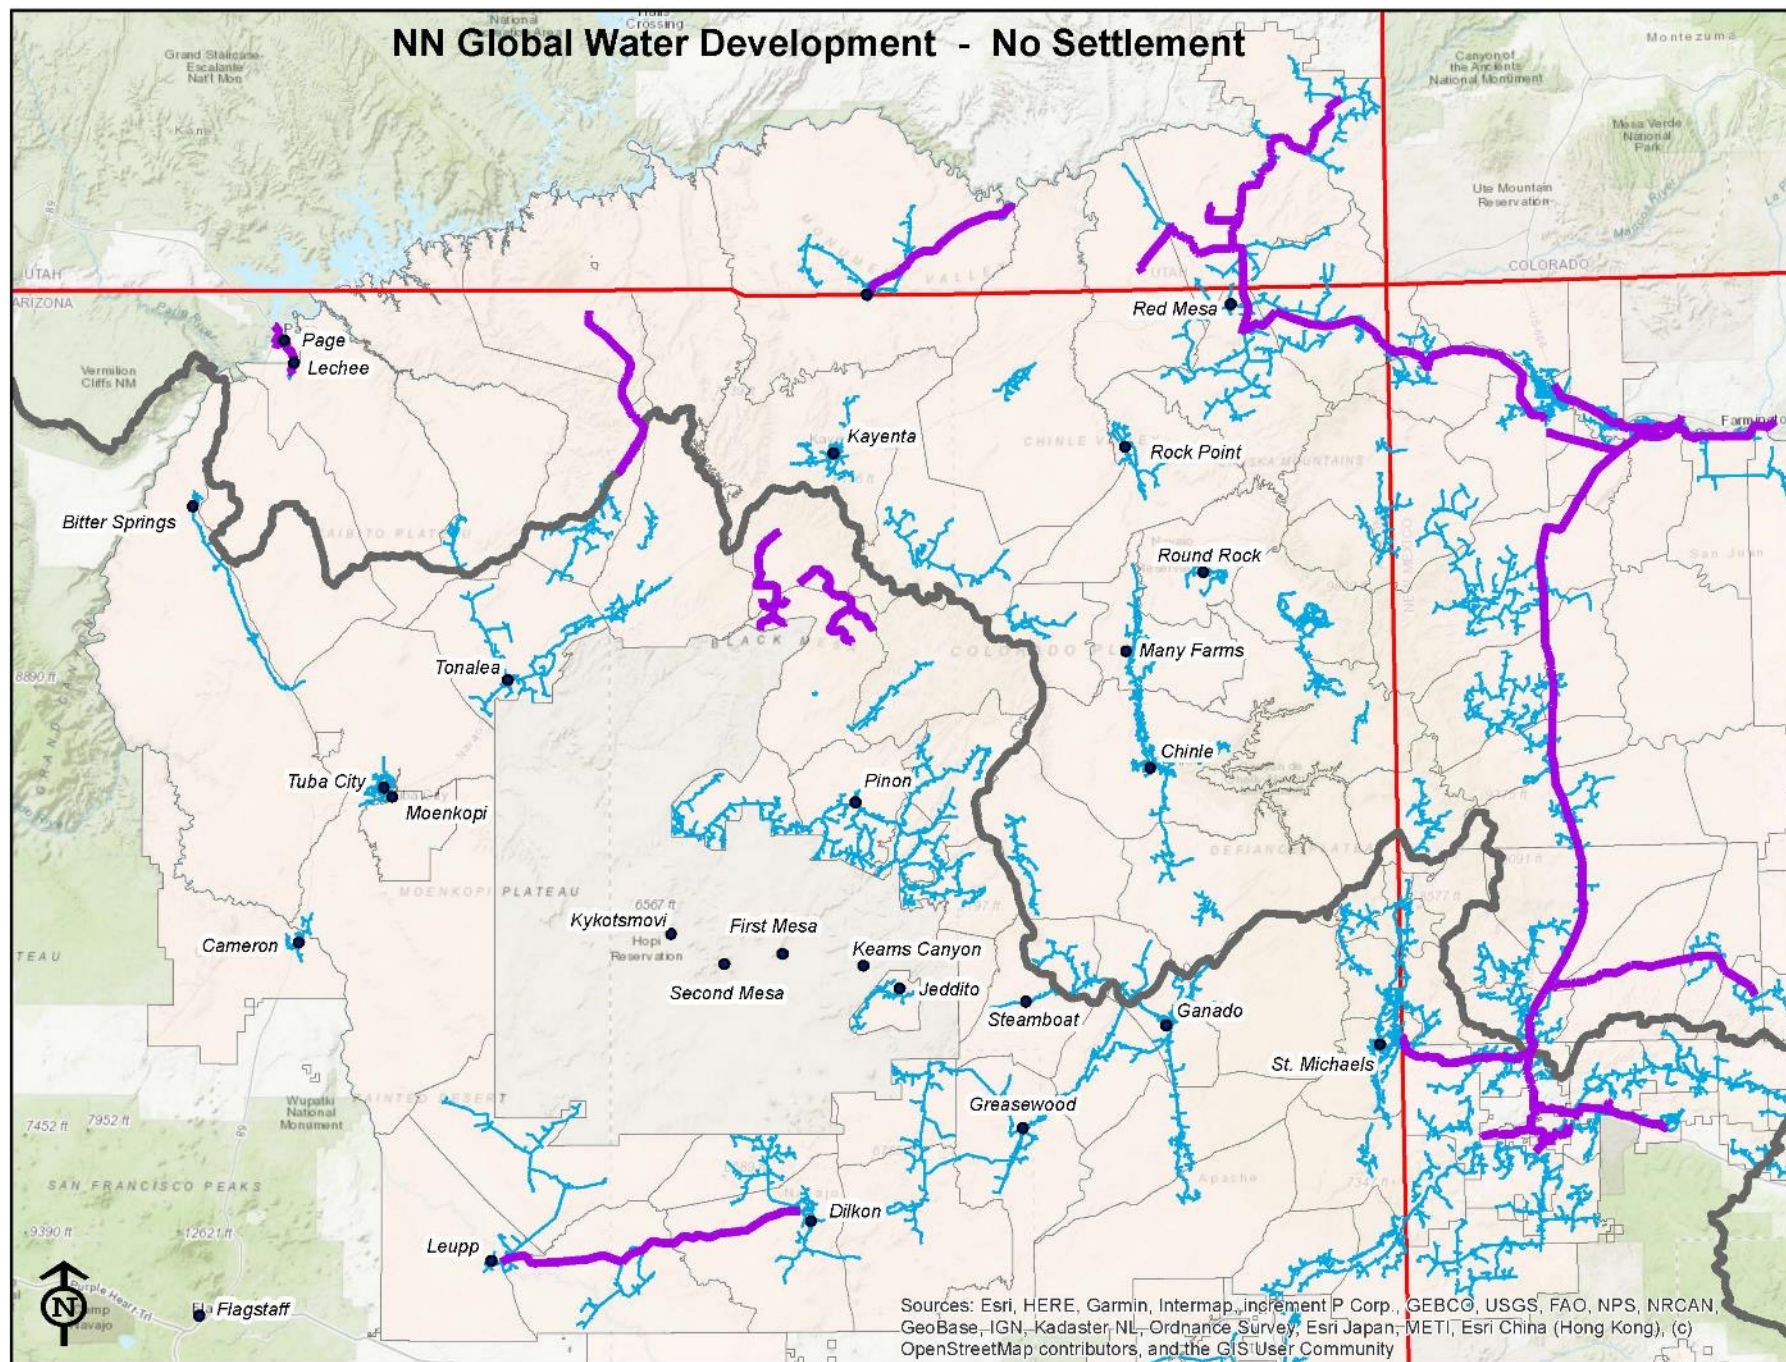



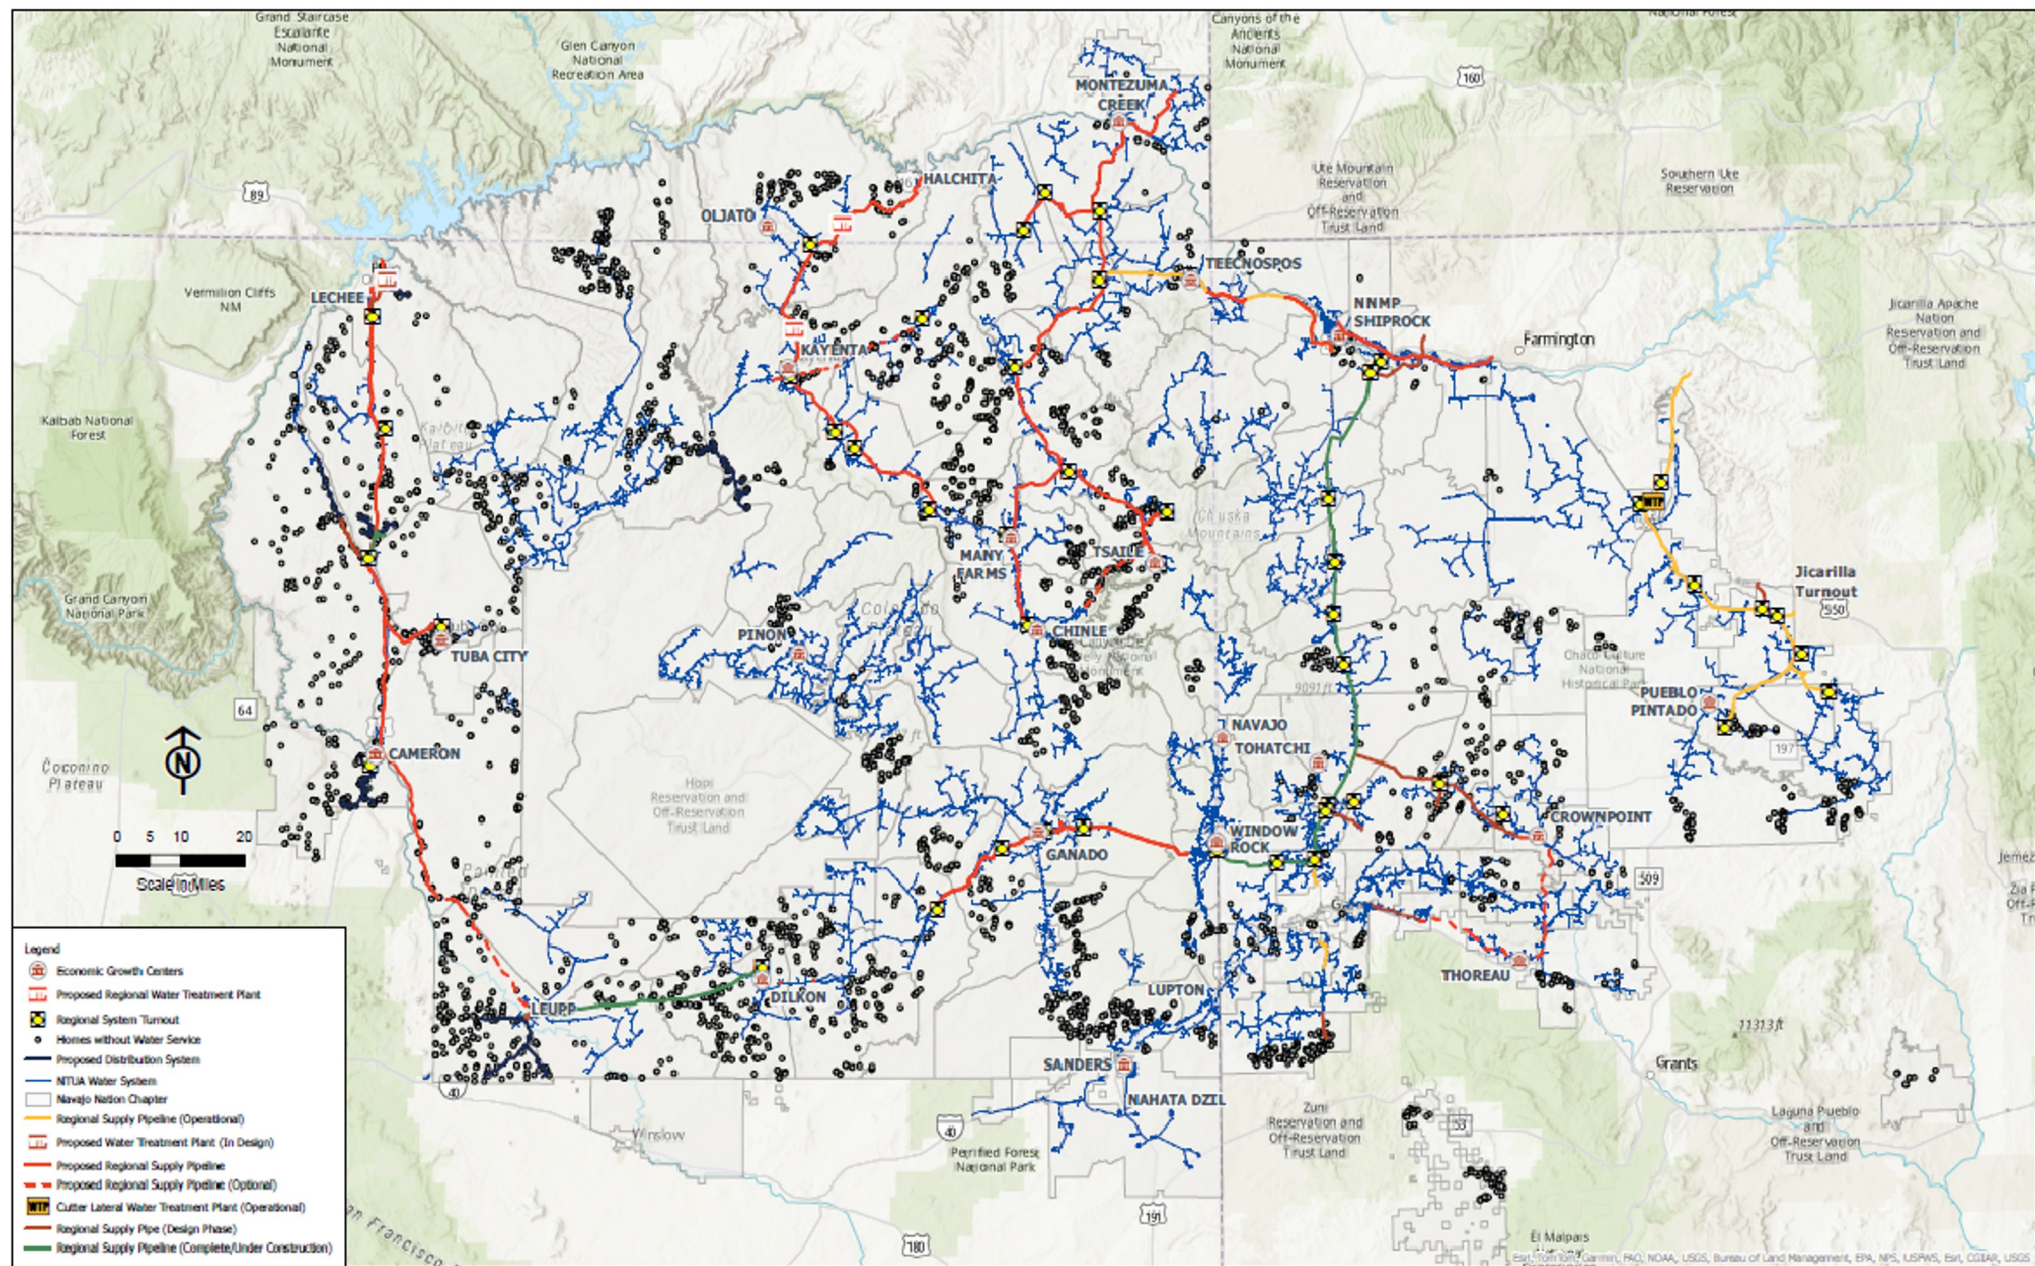

Last update: March 4, 2024

## Navajo Tribal Utility Authority Global Water Map

Homes without Water Services on the Navajo Nation





**PRESERVING DINÉTAH:  
WATER SECURITY FOR  
GENERATIONS**